
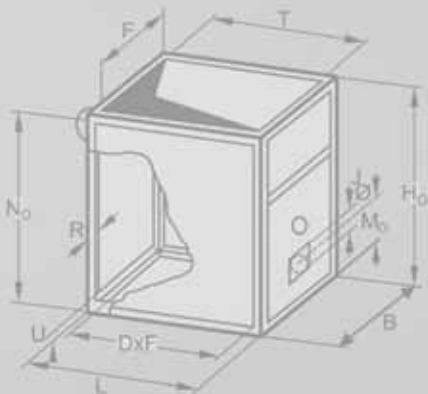


Technical documentation

Warm air heater

WS • WO

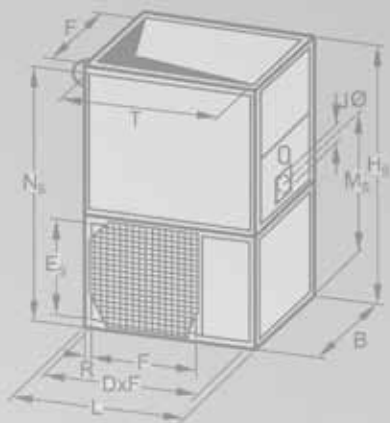

Indirectly fired air heater WS


WS indirectly fired air heater to DIN 4794 for heating oil, natural gas and liquefied gas.

CE ID number:

CE 0085 AR 0130

Calculating approximate heat demand:

As the case with other heaters, it is always advisable to calculate the heat demand to DIN 4701 exactly when dimensioning indirectly fired air heaters. The heat demand can be approximated with the aid of the diagram below.

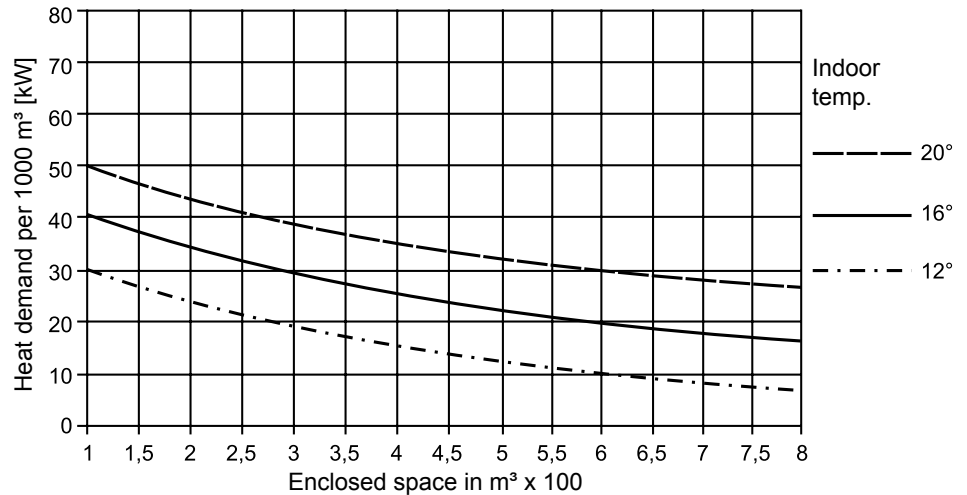

Structure:

Exterior walls: 25 cm masonry or equivalent
 Roofing: lightweight concrete or equivalent
 Heating in recirculating-air mode

Correction factors:

Add:


- For corrugated roofing, not insulated + 40 %
- For corrugated roofing, thin insulation (20 mm) + 20 %
- For wooden roof with tar-paper or sheet metal + 20 %
- For metal exterior wall, not insulated + 20 %
- For extremely narrow buildings + 20 %
- For large windows in exterior wall + 10 %

Deduct:


- For exterior wall 75 % adjoining another building - 15 %
- For exterior wall 50 % adjoining another building - 10 %
- For exterior wall without windows, solid brick - 30 %
- For heated upper storey - 30 %
- For heated annex on each side - 10 %

Dimensions / Weights WS/WO

WS with fan

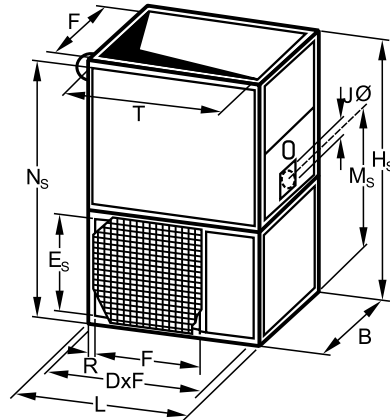


vertical

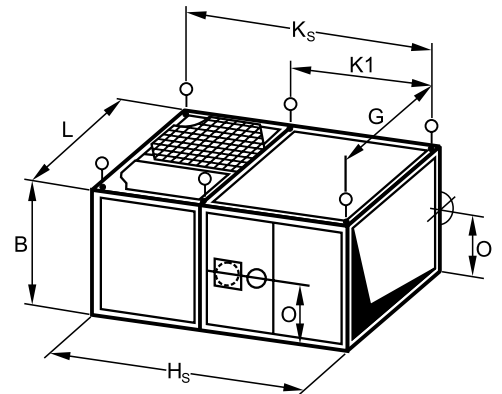


horizontal

WO without fan

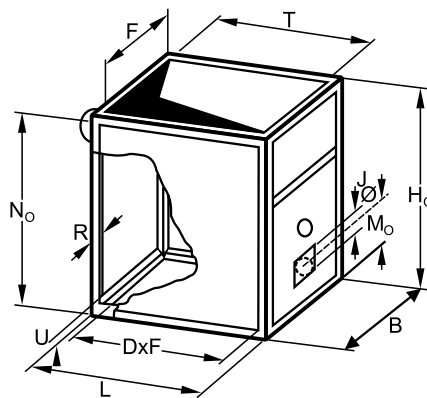

vertical

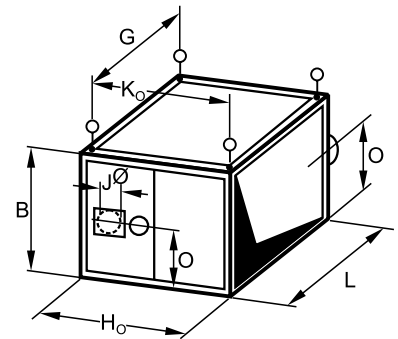

horizontal

Technical data

| WS/WO | | 40 | 63 | 100 | 160 | 250 | 400 | |
|---------------------|-------------------|------|------|------|------|------|------|-----|
| External dimensions | L mm | 630 | 800 | 1100 | 1250 | 1600 | 1600 | |
| | B mm | 630 | 700 | 730 | 910 | 1090 | 1090 | |
| | H _s mm | 1260 | 1410 | 1730 | 1950 | 2510 | 2630 | |
| | H ₀ mm | 800 | 910 | 1100 | 1250 | 1600 | 1600 | |
| Air inlet | E _s mm | 380 | 420 | 550 | 580 | 790 | 910 | |
| | F mm | 550 | 620 | 650 | 790 | 970 | 970 | |
| | R mm | 40 | 40 | 40 | 60 | 60 | 60 | |
| | U mm | 40 | 40 | 40 | 60 | 60 | 60 | |
| | D mm | 550 | 720 | 1020 | 1130 | 1480 | 1480 | |
| | | | | | | | | |
| Air outlet | F mm | 550 | 620 | 650 | 790 | 970 | 970 | |
| | T mm | 550 | 720 | 1020 | 1130 | 1480 | 1480 | |
| Fire tube | Length appr. | mm | 97 | 92 | 101 | 88 | 140 | 190 |
| | ∅ mm | 1480 | 178 | 178 | 195 | 245 | 345 | |
| | N _s mm | 1075 | 1250 | 1483 | 1754 | 2250 | 2370 | |
| | N ₀ mm | 615 | 750 | 853 | 1054 | 1340 | 1340 | |
| | O mm | 315 | 350 | 365 | 455 | 545 | 545 | |
| Burner connection | J∅ mm | 151 | 151 | 151 | 186 | 186 | 265 | |
| | M _s mm | 715 | 743 | 945 | 1029 | 1311 | 1431 | |
| | M ₀ mm | 255 | 243 | 315 | 329 | 401 | 401 | |
| | O mm | 315 | 350 | 365 | 455 | 545 | 545 | |
| Lifting lugs | G mm | 600 | 770 | 1070 | 1210 | 1560 | - | |
| | K _s mm | 1230 | 1380 | 1700 | 1910 | 2470 | - | |
| | K ₁ mm | - | - | - | 1250 | 1600 | - | |
| | K ₀ mm | 770 | 880 | 1070 | 1210 | 1560 | - | |
| Burner | Tube max. length | mm | 105 | 135 | 170 | 210 | 225 | |
| | Tube min. length | mm | 70 | 100 | 120 | 150 | 150 | |
| | Nozz. spray angle | ° | 60 | 60 | 60 | 60 | 60 | |
| Weight | WS | kg | 130 | 190 | 240 | 400 | 650 | |
| | WO | kg | 90 | 130 | 170 | 270 | 400 | |

Type selection WS/WO

| Type | Heating capacity | Operating point I for fresh air approx. 60K | | Operating point II for mixed air approx. 50 K | | Operating point III for recirculated air approx. 40 K | | Required boiler draught | Flue gas mass flow rate (kg/h) | | | | Flue gas pipe |
|---------|------------------|---|--------------------------|---|--------------------------|---|--------------------------|--------------------------------|--------------------------------|-----------------------|---------------------|----------------------|---------------|
| | | Air flow 20°C | Ex. air temp. -air temp. | Air flow 20°C | Ex. air temp. -air temp. | Air flow 20°C | Ex. air temp. -air temp. | | Heating oil EL | Natural gas E | Natural gas LL | Liqefied gas | |
| WS / WO | Q [kW] | V I [m³/h] | Δt_A [K] | V II [m³/h] | Δt_A [K] | V III [m³/h] | Δt_A [K] | with / without turbulator [Pa] | CO ₂ 13 % | CO ₂ 9,5 % | CO ₂ 9 % | CO ₂ 11 % | Ø [mm] |
| 40-1 | 20 | 1000 | 176 | 1250 | 167 | - | - | 3 | 33 | not permissible | | | 148 |
| -2 | 25 | 1250 | 202 | 1600 | 191 | 2000 | 178 | 4 | 42 | 45 | 46 | 43 | |
| -3 | 32 | 1600 | 241 | 2000 | 226 | 2500 | 212 | 7 | 54 | 57 | 59 | 55 | |
| 63-1 | 32 | 1600 | 190 | 2000 | 176 | 2500 | 169 | 4 | 54 | not permissible | | | 178 |
| -2 | 40 | 2000 | 210 | 2500 | 200 | 3200 | 190 | 5 | 67 | 71 | 74 | 69 | |
| -3 | 50 | 2500 | 250 | 3200 | 236 | 4000 | 229 | 9 | 84 | 89 | 93 | 86 | |
| 100-1 | 50 | 2500 | 190 | 3200 | 175 | - | - | 5 | 84 | 89 | 93 | 86 | 178 |
| -2 | 63 | 3200 | 218 | 4000 | 200 | 5000 | 175 | 6 | 105 | 112 | 117 | 108 | |
| -3 | 80 | 1600 | 248 | 5000 | 225 | 6300 | 210 | 9 | 134 | 142 | 148 | 137 | |
| 160-1 | 80 | 4000 | 220 | 5000 | 206 | 6300 | 193 | 4 | 134 | 142 | 148 | 137 | 195 |
| -2 | 100 | 5000 | 245 | 6300 | 230 | 8000 | 210 | 6 | 167 | 178 | 185 | 172 | |
| -3 | 125 | 6300 | 260 | 8000 | 235 | 10000 | 220 | 10 | 209 | 222 | 231 | 214 | |
| 250-1 | 130 | 6300 | 193 | 8000 | 178 | 10000 | 165 | 4 | 222 | 235 | 245 | 227 | 245 |
| -2 | 160 | 8000 | 210 | 10000 | 194 | 12500 | 180 | 6 | 267 | 285 | 296 | 274 | |
| -3 | 200 | 10000 | 235 | 12500 | 214 | 16000 | 195 | 13 | 334 | 356 | 370 | 343 | |
| -4 | 250 | 12500 | 252 | 16000 | 236 | - | - | 17 | 417 | 445 | 462 | 429 | |
| 400-1 | 200 | 10000 | 235 | 12500 | 214 | 16000 | 195 | 8 | 334 | 356 | 370 | 343 | 345 |
| -2 | 250 | 10000 | 252 | 16000 | 236 | 20000 | 212 | 12 | 417 | 445 | 462 | 429 | |
| -3 | 320 | 16000 | 252 | 25000 | 240 | 25000 | 221 | 18 | 534 | 569 | 591 | 549 | |

● These air flows are not suitable for fresh air operation.

T: Delivery with turbulator

Note:

- Maximum suction temperature for WS 40 °C
- Minimum discharge temperature for WS/WO 40 °C
- Minimum waste gas temperature in accordance with DIN 4794: 160 °C

Drive / Sound pressure level for WS Unit resistance for WO

WS Motor capacity, Fan speed, Sound pressure level

| External pressure Type | Air volume m ³ /h | free discharge up to 25 Pa | | | 50 Pa | | | 100 Pa | | | 200 Pa | | | 300 Pa | | | 400 Pa | | |
|---------------------------|------------------------------------|-------------------------------|----------------------------|-----------|--------------------|----------------------------|-----------|--------------------|----------------------------|-----------|--------------------|----------------------------|--------------------|--------------------|----------------------------|-----------|-------------|----------------------------|-----------|
| | | Motor kW | Venti min ⁻¹ | Lp dBA | Motor kW | Venti min ⁻¹ | Lp dBA | Motor kW | Venti min ⁻¹ | Lp dBA | Motor kW | Venti min ⁻¹ | Lp dBA | Motor kW | Venti min ⁻¹ | Lp dBA | Motor kW | Venti min ⁻¹ | Lp dBA |
| WS 40 1-3 | 1 000 | | | | 0,25 ⁻¹ | 50 | | 0,25 ⁻¹ | 52 | | 0,37 ⁻¹ | 56 | | 0,37 ⁻² | 57 | | | | |
| | 1 250 | 0,25 ⁻¹ | | 50 | 0,25 ⁻¹ | 51 | | 0,25 ⁻² | 53 | | 0,37 ⁻¹ | 57 | | 0,37 ⁻² | 58 | | | | |
| | 1 600 | 0,25 ⁻¹ | | 51 | 0,25 ⁻² | 52 | | 0,25 ⁻³ | 54 | | 0,37 ⁻² | 58 | | 0,37 ⁻³ | 59 | | | | |
| | 2 000 | 0,25 ⁻² | | 52 | 0,25 ⁻³ | 53 | | 0,37 ⁻² | 59 | | 0,37 ⁻³ | 59 | | 0,37 ⁻³ | 60 | | | | |
| | 2 500 | 0,37 ⁻² | | 53 | 0,37 ⁻³ | 55 | | | | | | | | | | | | | |
| WS 63 1-3 | 1 600 | | | | | | | | | | | | 0,55 ⁻¹ | 54 | 0,55 ⁻³ | 56 | | | |
| | 2 000 | | | | | | | | | | | | 0,55 ⁻² | 55 | 0,55 ⁻³ | 57 | | | |
| | 2 500 | 0,55 ⁻¹ | | 47 | 0,55 ⁻¹ | 49 | | 0,55 ⁻¹ | 52 | | 0,55 ⁻² | 54 | | 0,55 ⁻³ | 56 | | | | |
| | 3 200 | 0,55 ⁻³ | | 49 | 0,55 ⁻² | 51 | | 0,55 ⁻² | 53 | | 0,55 ⁻³ | 55 | | | | | | | |
| | 4 000 | 0,55 ⁻³ | | 50 | | | | | | | | | | | | | | | |
| WS 100 1-3 | 2 500 | 0,37 | 490 | 55 | 0,37 | 610 | 55 | 0,37 | 770 | 55 | 0,37 | 770 | 57 | 0,55 | 1000 | 60 | 0,75 | 1120 | 63 |
| | 3 200 | 0,37 | 680 | 58 | 0,37 | 770 | 58 | 0,55 | 880 | 59 | 0,55 | 880 | 61 | 0,75 | 1120 | 64 | 1,1 | 1410 | 66 |
| | 4 000 | 0,55 | 770 | 64 | 0,75 | 900 | 64 | 0,75 | 900 | 65 | 1,1 | 1120 | 66 | 1,5 | 1260 | 66 | 1,5 | 1420 | 67 |
| | 5 000 | 1,1 | 1000 | 67 | 1,1 | 1000 | 67 | 1,5 | 1260 | 69 | 1,5 | 1260 | 69 | 2,2 | 1430 | 70 | 2,2 | 1430 | 70 |
| | 6 300 | 2,2 | 1260 | 69 | 2,2 | 1400 | 70 | | | | | | | | | | | | |
| WS 160 1-3 | 4 000 | 0,37 | 435 | 54 | 0,37 | 490 | 54 | 0,55 | 610 | 55 | 0,75 | 690 | 57 | 1,1 | 810 | 61 | 1,1 | 810 | 64 |
| | 5 000 | 0,55 | 560 | 54 | 0,55 | 560 | 55 | 0,75 | 690 | 57 | 1,1 | 800 | 62 | 1,5 | 910 | 64 | 2,2 | 1010 | 67 |
| | 6 300 | 1,1 | 620 | 58 | 1,1 | 700 | 58 | 1,5 | 800 | 60 | 1,5 | 900 | 63 | 2,2 | 980 | 65 | 2,2 | 1010 | 67 |
| | 8 000 | 1,5 | 800 | 64 | 2,2 | 880 | 64 | 2,2 | 900 | 65 | 2,2 | 1010 | 66 | 3,0 | 1145 | 67 | 3,0 | 1250 | 68 |
| | 10 000 | 3,0 | 900 | 67 | 3,0 | 1010 | 68 | | | | | | | | | | | | |
| WS 250 1-4 | 6 300 | 0,55 | 360 | 61 | 0,55 | 410 | 62 | 0,75 | 500 | 65 | 1,1 | 625 | 67 | 1,5 | 720 | 69 | 1,5 | 720 | 70 |
| | 8 000 | 1,1 | 400 | 62 | 1,1 | 450 | 63 | 1,1 | 555 | 66 | 1,5 | 635 | 68 | 2,2 | 720 | 70 | 2,2 | 800 | 71 |
| | 10 000 | 1,5 | 500 | 63 | 1,5 | 550 | 65 | 1,5 | 550 | 66 | 2,2 | 715 | 69 | 3,0 | 800 | 70 | 3,0 | 800 | 72 |
| | 12 500 | 2,2 | 570 | 64 | 2,2 | 570 | 66 | 3,0 | 710 | 67 | 3,0 | 800 | 70 | 5,5 | 800 | 71 | 5,5 | 925 | 73 |
| | 16 000 | 5,5 | 800 | 66 | 5,5 | 870 | 67 | 5,5 | 870 | 68 | 5,5 | 870 | 71 | | | | | | |
| WS 400 1-3 | 10 000 | 1,5 | 285 | 67 | 1,5 | 330 | 67 | 2,2 | 410 | 68 | 2,2 | 510 | 69 | 3,0 | 575 | 70 | 3,0 | 640 | 70 |
| | 12 500 | 2,2 | 330 | 68 | 2,2 | 410 | 68 | 2,2 | 460 | 69 | 3,0 | 570 | 70 | 4,0 | 640 | 71 | 4,0 | 715 | 71 |
| | 14 000 | 2,2 | 410 | 69 | 3,0 | 460 | 69 | 3,0 | 510 | 70 | 4,0 | 570 | 71 | 4,0 | 650 | 71 | 5,5 | 715 | 71 |
| | 16 000 | 3,0 | 460 | 69 | 3,0 | 515 | 70 | 4,0 | 570 | 70 | 4,0 | 635 | 71 | 5,5 | 720 | 72 | 5,5 | 720 | 72 |
| | 18 000 | 4,0 | 530 | 70 | 4,0 | 560 | 70 | 5,5 | 600 | 71 | 5,5 | 660 | 72 | 7,5 | 720 | 72 | 7,5 | 760 | 73 |
| | 20 000 | 5,5 | 580 | 70 | 5,5 | 640 | 71 | 5,5 | 640 | 71 | 7,5 | 720 | 72 | 7,5 | 730 | 73 | 11 | 830 | 74 |
| | 25 000 | 11 | 735 | 72 | 11 | 740 | 73 | 11 | 740 | 73 | | | | | | | | | |


WS 40 and WS 63: Operating points are achieved through switch board or by connection to one of the motor steps ⁻¹), ⁻²), ⁻³)

Sound pressure level in dB(A) at 2 m distance with free air inlet/outlet.

The air volume is reduced by about 17 % in the case of duct air filters or 2 filter frames;
suction with filter frame is not permissible!


WO Unit resistance

with flow across
the whole cross section

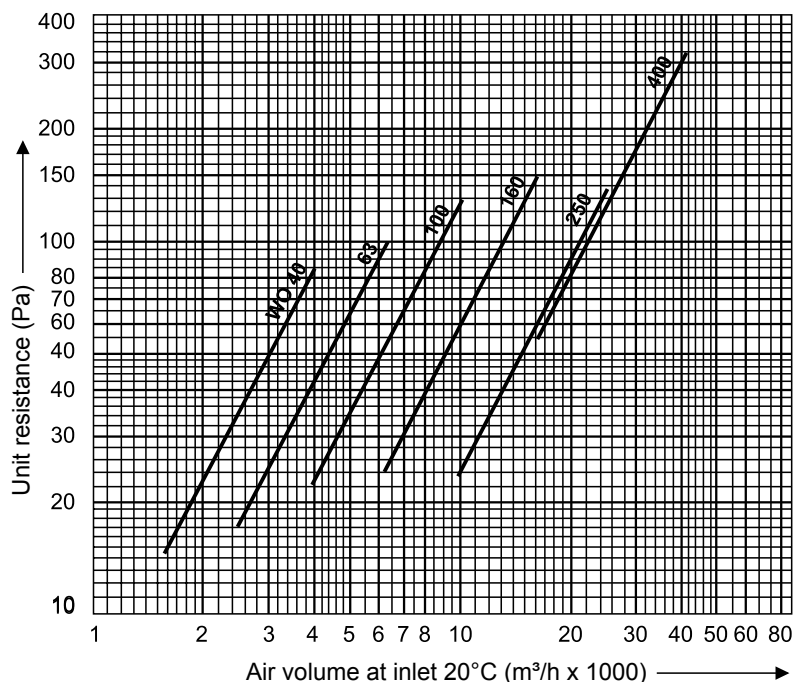

Fitting options of accessories WS


demonstrated on a vertical unit

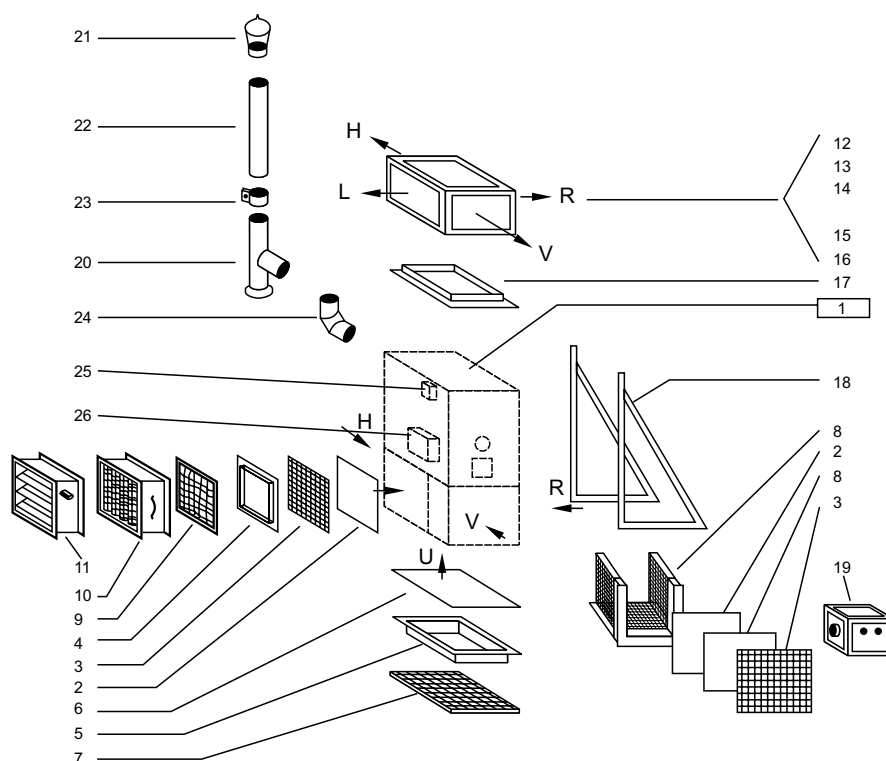

| | | WS 40/63 | | | | | WS 100-400 | | | | |
|-------|--|----------|------|-------|------|---------------|------------|------|-------|------|---------------|
| | | front | back | right | left | top bottom | front | back | right | left | top bottom |
| 1 | Warm air heater WS - vertical / horizontal | | | | | | | | | | |
| | Air inlet | | | | | | | | | | |
| 2 | Dummy plate | F | B | R | L | - | - | B | R | L | - |
| 3 | Air intake grille | F | B | R | L | - | - | B | R | L | - |
| 4 / 5 | Duct connection frame | - | - | - | - | Bo | - | - | - | - | Bo |
| 6 | Dummy plate | - | - | - | - | Bo | - | - | - | - | Bo |
| 7 | Air intake grille | - | - | - | - | Bo | - | - | - | - | Bo |
| 8 | Slide-in filter with mat and inspection door | F | - | - | - | - | - | - | - | - | - |
| 9 | Filter frame with mat | - | - | - | - | - | - | B | R | L | - |
| 10 | Duct air filter with mat | - | - | - | - | - | - | B | R | L | - |
| 11 | Damper | F | B | R | L | - | - | B | R | L | - |
| | Air outlet | | | | | | | | | | |
| 12 | Air outlet hood | F | B | R | L | - | F | B | R | L | - |
| 13 | with 2 grilles | | | | | | | | | | |
| 14 | with 3 grilles | | | | | | | | | | |
| 15 | Duct connection hood | F | B | R | L | - | F | B | R | L | - |
| 16 | broad side | - | - | R | L | - | - | - | R | L | - |
| 17 | narrow side | F | - | - | - | - | F | - | - | - | - |
| | Duct connection frame | - | - | - | - | Bo | - | - | - | - | T |
| | Other accessories | | | | | | | | | | |
| 18 | Set of brackets for horizontal appliance | | | | | | | | | | |
| 19 | Combustion air intake hood | | | | | | | | | | |
| - | (switch board at the front is not possible) | | | | | | | | | | |
| - | Set of lifting lugs for horizontal appliance WS 40 to WS 250 | | | | | | | | | | |
| - | Cleaning brush | | | | | | | | | | |
| | Smoke tubes | | | | | | | | | | |
| 20 | Smoke tube branche | | | | | | | | | | |
| 21 | Smoke tube rain protection hood | | | | | | | | | | |
| 22 | Smoke tube 1000 mm length, pluggable up to WS 250 | | | | | | | | | | |
| 23 | Smoke tube sleeve for WS 400 | | | | | | | | | | |
| 24 | Smoke tube bend 90°C with soot door | | | | | | | | | | |
| | Electrical accessories | | | | | | | | | | |
| 25 | Double and safety thermostat | | | | | | | | | | |
| 26 | Switch board fitted below double and safety thermostat | - | - | R | L | - | - | - | R | L | - |
| | For any further accessories see Chapter Accessories. | | | | | | | | | | |

Fitting options of accessories WO

demonstrated on a vertical unit

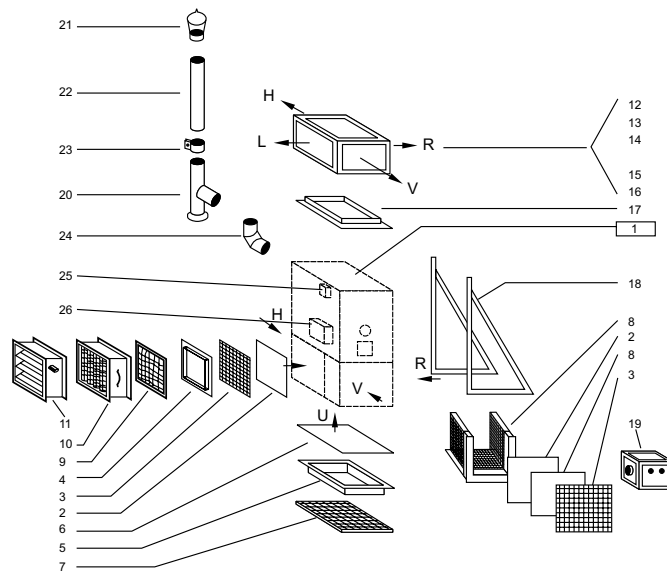


| | | WO 40-400 | | | |
|-------------------------------|--|-----------|-------|------|---------------|
| | | front | right | left | top bottom |
| 1 | Warm air heater WS - vertical / horizontal | | | | |
| Air inlet | | | | | |
| 2 | Dummy plate | - | - | - | - |
| 3 | Duct connection frame | - | - | - | Bo |
| Air outlet | | | | | |
| 4 | Air outlet hood | F | R | L | - |
| 5 | with 2 grilles | | | | |
| 6 | with 3 grilles | F | R | L | - |
| 7 | with 4 grilles | - | R | L | - |
| 8 | Duct connection hood | - | - | - | - |
| | broad side | | | | |
| | narrow side | F | - | - | - |
| 9 | Duct connection frame | - | - | - | T |
| Other accessories | | | | | |
| 10 | Combustion air intake hood | | | | |
| - | Set of lifting lugs for horizontal appliance WS 40 to WS 250 | | | | |
| - | Cleaning brush | | | | |
| Smoke tubes | | | | | |
| 11 | Smoke tube branche | | | | |
| 12 | Smoke tube rain protection hood | | | | |
| 13 | Smoke tube 1000 mm length, pluggable up to WS 250 | | | | |
| 14 | Smoke tube sleeve for WS 400 | | | | |
| 15 | Smoke tube bend 90°C with soot door | | | | |
| - | Smoke tube insulation (on inquiry) | | | | |
| Electrical accessories | | | | | |
| 16 | Double and safety thermostat | | | | |
| | For any further accessories see chapter accessories. | | | | |

Accessories - Dimensions WS/WO

Duct connection frame


air inlet lateral/at the rear



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|-----|-----|-----|-----|
| F | 530 | 600 | 630 | 770 | 950 | 950 |
| E | 360 | 400 | 530 | 560 | 770 | 890 |
| Z | 30 | 30 | 30 | 30 | 30 | 30 |
| H | 26 | 26 | 26 | 26 | 26 | 26 |
| appr. kg | 2 | 2,5 | 2,5 | 3 | 3,5 | 3,5 |

Duct connection frame

air inlet at the bottom




| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|-----------------|-----|-----|------|------|------|------|
| clear width - F | 530 | 600 | 630 | 770 | 950 | 950 |
| clear width - D | 530 | 700 | 1000 | 1110 | 1460 | 1460 |
| Z | 30 | 30 | 30 | 30 | 30 | 30 |
| H | 26 | 26 | 26 | 26 | 26 | 26 |
| appr. kg | 2 | 2,5 | 3,5 | 4 | 5 | 5 |

Spare filter mats for slide-in and frame filters

| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|--------|------|------|-----|-----|------|------|
| length | 1220 | 1380 | 720 | 880 | 1060 | 1060 |
| height | 650 | 820 | 620 | 670 | 880 | 1000 |

Duct air filters with filter mat




| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|----|----|-----|-----|-----|-----|
| E | - | - | 550 | 580 | 790 | 910 |
| F | - | - | 650 | 790 | 970 | 970 |
| T | - | - | 300 | 340 | 340 | 340 |
| Z | - | - | 40 | 60 | 60 | 60 |
| appr. kg | - | - | 30 | 50 | 65 | 72 |

Spare filter mat for duct air filter

| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|--------|----|----|------|------|------|------|
| length | - | - | 1880 | 2290 | 3020 | 3020 |
| height | - | - | 535 | 590 | 810 | 925 |


Damper



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|-----|-----|-----|-----|
| F | 530 | 600 | 630 | 770 | 950 | 950 |
| E | 360 | 400 | 530 | 560 | 770 | 890 |
| T | 120 | 120 | 120 | 120 | 120 | 120 |
| Z | 26 | 26 | 26 | 26 | 26 | 26 |
| appr. kg | 5 | 7 | 8 | 13 | 15 | 23 |

Air outlet hood

with 2 grilles
with 3 grilles narrow and/or
with 4 grilles broad side




Grille with adjustable blades

| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|------|------|------|------|
| L | 630 | 800 | 1100 | 1250 | 1600 | 1600 |
| B | 630 | 700 | 730 | 910 | 1090 | 1090 |
| H | 200 | 200 | 300 | 300 | 420 | 420 |
| appr. kg | 17 | 22 | 32 | 53 | 57 | 57 |

Accessories - Dimensions WS/WO

Duct connection hood


broad side



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|------|------|------|------|
| L | 630 | 800 | 1100 | 1250 | 1600 | 1600 |
| B | 630 | 700 | 730 | 910 | 1090 | 1090 |
| H | 300 | 300 | 300 | 300 | 420 | 420 |
| E | 220 | 220 | 220 | 180 | 300 | 300 |
| F | 550 | 720 | 1020 | 1130 | 1480 | 1480 |
| appr. kg | 20 | 24 | 32 | 53 | 57 | 57 |

Duct connection hood


narrow side



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|------|------|------|------|
| L | 630 | 800 | 1100 | 1250 | 1600 | 1600 |
| B | 630 | 700 | 730 | 910 | 1090 | 1090 |
| H | 300 | 300 | 400 | 500 | 700 | 700 |
| E | 220 | 220 | 320 | 380 | 580 | 580 |
| F | 550 | 620 | 650 | 790 | 970 | 970 |
| appr. kg | 20 | 24 | 40 | 70 | 90 | 90 |


Duct connection frame

air outlet



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|------|------|------|------|
| F | 530 | 600 | 630 | 770 | 950 | 950 |
| D | 530 | 700 | 1000 | 1110 | 1460 | 1460 |
| Z | 30 | 30 | 30 | 30 | 30 | 30 |
| H | 26 | 26 | 26 | 26 | 26 | 26 |
| appr. kg | 2 | 2,5 | 3,5 | 4 | 5 | 5 |


Bracket

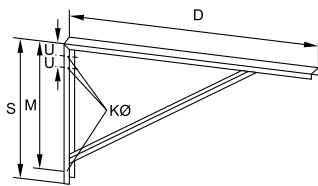

| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------------|------|------|------|------|-----|-----|
| D | 1300 | 1450 | 1650 | 2000 | - | - |
| S | 500 | 500 | 800 | 1000 | - | - |
| M | 450 | 450 | 740 | 900 | - | - |
| U | 50 | 50 | 60 | 80 | - | - |
| K Ø | 14 | 14 | 14 | 18 | - | - |
| appr. kg (set) | 16 | 18 | 21 | 60 | - | - |

Combustion air intake hood


Combustion air intake left or right, interchangeable



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|-----|-----|------|------|
| B | 630 | 630 | 630 | 800 | 1000 | 1000 |
| L | 460 | 460 | 460 | 630 | 830 | 830 |
| H | 630 | 630 | 630 | 800 | 1000 | 1000 |
| N | 315 | 315 | 315 | 270 | 300 | 300 |
| O | 25 | 25 | 25 | 30 | 30 | 30 |
| K Ø | 229 | 229 | 229 | 322 | 404 | 404 |
| appr. kg | 33 | 33 | 33 | 45 | 68 | 68 |

Smoke tube branch


with soot collector



| WS/WO | 40 | 63 | 100 | 160 | 250 | 400 |
|----------|-----|-----|-----|-----|-----|------|
| H | 540 | 590 | 590 | 700 | 900 | 1080 |
| T | 300 | 340 | 340 | 400 | 510 | 690 |
| Z | 215 | 250 | 250 | 300 | 390 | 390 |
| internal | | | | | | |
| d Ø | 150 | 180 | 180 | 200 | 250 | 350 |
| external | | | | | | |
| D Ø | 146 | 179 | 179 | 199 | 249 | 349 |
| appr. kg | 15 | 18 | 18 | 21 | 29 | 48 |

Burner plate

bored



| WS/WO | ØA | ØB | C | D | E | plate type |
|-------------|-----|-----|-----|-----|-----|------------|
| 40/63/100 | 120 | 150 | M 8 | 210 | 210 | A |
| 40/63/100 | 130 | 170 | M 8 | 210 | 210 | B |
| 160/250/400 | 130 | 150 | M 8 | 320 | 320 | C |
| 160/250/400 | 150 | 170 | M 8 | 320 | 320 | D |
| 160/250/400 | 150 | 200 | M10 | 320 | 320 | E |

Accessories – Control elements WS/WO

| | |
|--|--|
| Double and safety thermostat fitted | 2 capillaries 350 mm length for fan, burner and burner safety control with restart locking device. Breaking capacity: 15 A, 230 V, 50 Hz |
| Terminal box fitted (for WS 40-400) | for connection of the double and safety thermostat as well as the fan to the terminal box |
| Room thermostat | in plastic casing for on-surface installation. Breaking capacity: 10 A at 230 V, 50 Hz, thermal return. Temperature range + 5 to + 30 °C, switch temperature difference 0,5 °C. |
| Room thermostat industrial version | in plastic casing 150 x 110 x 72 mm for on-surface installation. Switching capacity 16(4) A at 230 V / 50 Hz Temperature range 0 - 40 °C Switching differential $\pm 0,75$ K Degree of saturation IP 54 Part. No. 27 35 300 |
| Room thermostat clock | Plastic housing, 132 x 82 x 32 mm for socket installation, daytime and night-time temperatures can be set separately. Temperature decrease adjustable 2 - 10 K Switching capacity: 10(4) A at 230 V / 50 Hz Temperature range 5 - 40 °C Switching differential $\pm 0,1 - 3$ K Degree of protection IP 20 Part.No. 27 44 079 |
| Time switch daily and weekly programm and power reserve | for installation in switch board. Breaking capacity: 16 A at 230 V, 50 Hz. |
| Hours run meter for installation in switch board. | in plastic case, front frame 48 x 48 mm five-digit meter. Connection: 230 V, 50 Hz |
| Servomotor | to control fresh air or return air damper open/shut. Connection: 230 V, 50 Hz. |

Switch board WS

Switch board

- Terminal box for single speed function of WS 40 and WS 63
- 3-speed with „summer-off-winter“ switch for WS 40-63
- single-speed with „summer-off-winter“ switch for WS 100-400
- 2-speed with „summer-off-winter“ switch and speed selection switch for WS 100-400 (incl. control for burner 2-stage)

Technical data

| | Switch board | | | Starting mode | | | fuse A |
|---|--------------|------|-----|---------------|------------|-----------|-----------|
| | kW | Type | V | direct | Y-Δ | delayed | |
| | | | | A | A | A | |
| WS 40 3-speed | 0,25 | - | 230 | 2,5 | - | - | 6 |
| | 0,37 | - | 230 | 5,0 | - | - | 10 |
| WS 63 3-speed | 0,55 | - | 230 | 6,7 | - | - | 16 |
| | 0,37 | - | 400 | 1,15 | - | - | 4 |
| WS 100-400 single-speed | 0,55 | - | 400 | 1,5 | - | - | 6 |
| | 0,75 | - | 400 | 1,95 | - | - | 6 |
| | 1,1 | - | 400 | 2,8 | - | - | 10 |
| | 1,5 | - | 400 | 3,7 | - | - | 10 |
| | 2,2 | - | 400 | 5,1 | - | - | 16 |
| | 3,0 | - | 400 | 6,8 | - | - | 16 |
| | 4,0 | - | 400 | 9,0 | 5,2 | - | 20 |
| | 5,5 | - | 400 | 11,7 | 6,8 | - | 20 |
| | 7,5 | - | 400 | 15,6 | 9,1 | - | 25 |
| | 11,0 | - | 400 | 22,4 | 13,0 | - | 35 |
| WS 100-400 2-speed separate winding 1500/1000 min ⁻¹ | 0,37/0,11 | - | 400 | 1,45/0,65 | - | - | 6 |
| | 0,50/0,15 | - | 400 | 1,75/0,78 | - | - | 6 |
| | 0,75/0,27 | - | 400 | 2,70/1,60 | - | - | 10 |
| | 1,00/0,30 | - | 400 | 3,40/1,75 | - | - | 10 |
| | 1,50/0,50 | - | 400 | 4,40/2,40 | - | - | 10 |
| | 2,00/0,70 | - | 400 | 6,00/3,10 | - | - | 10 |
| | 3,00/0,90 | - | 400 | 7,50/3,40 | - | - | 16 |
| | 3,80/1,14 | - | 400 | - | - | 9,8/4,3 | 16 |
| | 5,00/1,70 | - | 400 | - | - | 13,5/6,0 | 20 |
| | 7,20/2,50 | - | 400 | - | - | 18,0/7,9 | 25 |
| 9,00/3,00 | - | 400 | - | - | 23,0/9,7 | 35 | |
| WS 100-400 2-speed Dahlander 1500/750 min ⁻¹ | 0,30/0,06 | - | 400 | 1,20/0,54 | - | - | 6 |
| | 0,50/0,10 | - | 400 | 1,80/0,75 | - | - | 10 |
| | 0,70/0,15 | - | 400 | 2,35/1,00 | - | - | 10 |
| | 1,00/0,22 | - | 400 | 3,10/1,40 | - | - | 16 |
| | 1,40/0,33 | - | 400 | 4,20/2,00 | - | - | 16 |
| | 2,00/0,45 | - | 400 | 5,30/2,50 | - | - | 16 |
| | 2,40/0,55 | - | 400 | 6,50/3,00 | - | - | 16 |
| | 3,60/0,90 | - | 400 | - | - | 9,70/4,7 | 16 |
| | 5,00 /1,40 | - | 400 | - | - | 12,70/7,5 | 20 |
| | 6,10/1,40 | - | 400 | - | - | 16,00/7,5 | 25 |
| 9,00/2,20 | - | 400 | - | - | 20,50/10,3 | 35 | |

Switch board accessories:

- Built-in hours run meter
- Built-in time switch with daily and weekly program and power reserve
- Design for threephase current burner up to 2,2 kW (WS 160-400)
- Control for servomotor open/shut

Special design WS/WO

Dismountable units

General:

All dismountable warm air heaters are assembled and then disassembled in the factory. Each component is marked to facilitate assembly on site. The casing panels are delivered together with the necessary bolts.


2 components - on extra price

WS/WO 40-63

Fan section complete
Upper section not split up
Heating furnace not split up

WS/WO 100-400

Fan section complete
Upper section with built in heating furnace

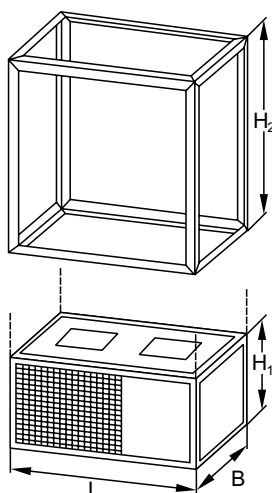


several compon. - on extra price

WS/WO 40-63

Fan section complete
Upper section split up
Heating furnace not split up

WS/WO 100-400

Fan section complete
Upper section split up in the middle
Heating furnace not split up

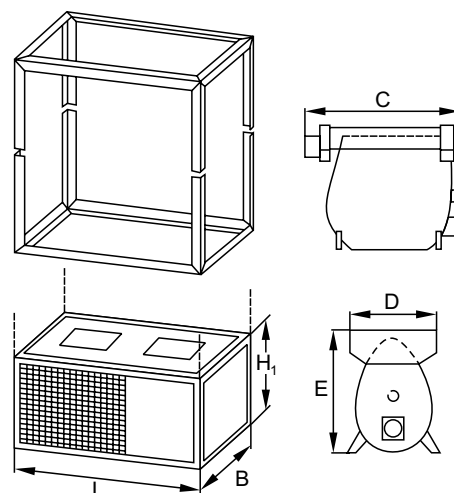

Dimensions

| WS/WO | | 40 | 63 | 100 | 160 | 250 | 400 |
|------------------------|-------------------|-----|-----|------|------|------|------|
| External casing | L mm | 630 | 800 | 1100 | 1250 | 1600 | 1600 |
| | B mm | 630 | 700 | 730 | 910 | 1090 | 1090 |
| | H ₁ mm | 460 | 500 | 630 | 700 | 910 | 1030 |
| | H ₂ mm | 800 | 910 | 1100 | 1250 | 1600 | 1600 |
| Heating furnace | C mm | 777 | 932 | 1243 | 1388 | 1755 | 1825 |
| | D mm | 539 | 615 | 638 | 790 | 1004 | 1004 |
| | E mm | 722 | 870 | 925 | 1105 | 1410 | 1410 |
| Weight heating furnace | Kg | 50 | 75 | 100 | 170 | 330 | 340 |

Further dismountable parts:

E.g. heating furnace split up, on inquiry and on extra price.

Assembly:

Install fan section vertically and without torsion, attach heat insulation at the bores using screws, fix panels at right at the bores using screws.

Note WS/WO

Thermostats

for burner control:

Warm air heaters may only be operated with 2 thermostats which switch off the burner independently.

One thermostat is constructed as monitoring device and the other as safety thermostat with restart locking device.

for fan control:

After the burner has been switched off, the fan must continue operation until the combustion chamber has cooled down sufficiently.

Warm air heaters by Wolf fulfill both requirements by means of double and safety thermostats.

Smoke tubes

If smoke tubes are used as steel chimneys, they are subject to approval of the respective building authorities.


Combustion air intake hood

In special cases, the combustion air must be taken in from outside via an airtight duct system.

e. g.: in car repair workshops or if the pressure between combustion chamber and installation room differs significantly.

The installations of warm air heaters in garages is only allowed for fresh air operation (recirculated air operation is not permitted).

Be sure to observe regulations for garages!

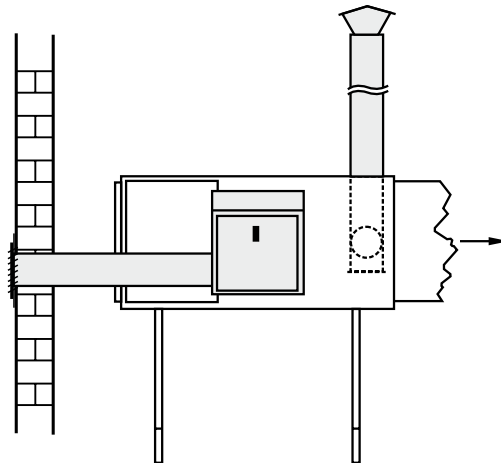




Gas-fired units

All types and sizes of units included in this list can also be operated with natural and liquid petroleum gas. The maximum load may not exceed that of oil-fired units.

The flame image, i. e. the combustion nucleus must have characteristics similar to those of an oil burner with a 60° nozzle.

Assembly/Commissioning – Maintenance WS/WO

| | |
|--|--|
| Installation | In accordance with the valid local and general directives on warm air heaters and the directives of the Brandversicherungskammer. |
| Foundation | Möglichst auf Betonsockel (Höhe 100–150 mm). Bei betoniertem Boden direkt auf dem Boden möglich. |
| Space required | For the installation and possibly exchange of a) fans with drive front or right or left b) thermostats left or right c) switch board left or right d) burner front Cleaning of heating compartments back and front |
| Flue gas guidance | Horizontal flue gas guidance as short as possible. Observe wall thickness and insulation. |
| Double and safety thermostat | If the thermostat was not installed and adjusted at the factory, fix to the casing with bolts at the holes punched out laterally. The sensor shall be positioned at least 40 mm in air direction behind the heating compartments. The thermostat shall be adjusted so that: Fan on at 40° C Fan off at 35° C Burner off at max. 80° C The safety thermostat shall be adjusted so that it will turn off the burner at 100° C and will be locked by a restart locking device. |
| Tasks before starting operation | Tighten bolts, in case they were loosened during transport. Check V-belt tension, tighten if necessary. Check direction and axial alignment of fan rotor. Open air intake and air outlet dampers. Check oil reserve, control gas pressure, open shut-off valves. Screw in fuses for burner and fan motor. Observe operating instructions of the manufacturer of burner and air suction fan. |
| Controls after starting operation | Check current consumption of the fan motor(s). It must not exceed the rated current as specified on motor name plate. Adjust overcurrent relay accordingly and carry out operation test by taking out a fuse (only necessary for threephase current). Measure chimney draught. Perform flue gas analysis. Attention: Depending on the type of construction of the chimney, the flue gas temperature must be adjusted so as to prevent damage. Minimum flue gas temperature in accordance with DIN 4794: 1600 C. Check sealing of the casing panels, tighten screws if necessary. Check air volume in units with duct connection. Switch off warm air heater only via room thermostat or control switch of the burner. Fan will continue operation for some time and is turned off automatically after the heating furnace has cooled down. Only then can the main electricity supply be turned off. |
| Maintenance | Cleaning of the heating furnace: In the case of oil-fired appliances, at the end of each heating season, if possible, or with the appearance of a soot layer. In the case of gas-fired appliances, at intervals of several years. Cleaning apertures become accessible by taking off front and rear insulating panels. Seal apertures tightly after cleaning. Casing, suction grille, discharge grille, fan casing and fan rotor must be cleaned at least once a year. (Do not use corrosive agents!) V-belt must be tightened several times during the first year of operation. |

| | | | | | | | | | | | |
|------------------------------------|--|---|---|---------------|-----------------|------------|-------------------|--|---------------------|--------|-------------|
| Offer/Order No. / / | | Date of delivery: | | | | | | | | | |
| Company: _____ Customer No.: _____ | | Date of order: _____ | | | | | | Ex warehouse | | | |
| | | Order No.: _____ | | | | | | | | | |
| | | Comm.: _____ | | | Pos.: _____ | | | | | | |
| | | Employee: _____ | | | | | | | | | |
| | | Address of delivery: _____ | | | | | | | | | |
| | | Advide note tel.. _____ | | | | | | <input type="checkbox"/> collective transport <input type="checkbox"/> by rail-express <input type="checkbox"/> by rail-part load <input type="checkbox"/> forwarding agency <input type="checkbox"/> collection | | | |
| Warm air heater | | Type | Heating cap. (kW) | | Air vol. (m³/h) | | ext. Pr (Pa) | | Pieces | Price | Total price |
| Basic unit |  |  |  | MotorV | | | kW | | | | |
| | | | |A | | | min ⁻¹ | | | | |
| | | | | Fan | | | min ⁻¹ | | | | |
| | | | | Motor pulley | | | Bg. mm Ø | | | | |
| | | | | Fan pulley | | | Bg. mm Ø | | | | |
| | | | | V-belt length | | | mm | | | | |
| | vertical <input type="checkbox"/> | horizontal right <input type="checkbox"/> | horizontal left <input type="checkbox"/> | | | | | | | | |
| | G = grille | H = hood | o = open | | | | | | | | |
| | F = filter | F = frame | | | | | | | | | |
| | P = plate | D = damper | | | | | | | | | |
| | | | | Air inlet | front | back | right | left | top | bottom | |
| | | | | Air outlet | | | | | | | |
| Air inlet | Duct connection frame | | | | | | | | | | |
| | Slide-in filter with mat and inspection door | | | | | | | | | | |
| | Duct air filter with mat | | | | | | | | | | |
| | Damper | | | | | | | | | | |
| | Manual lever with lock | | | | | | | | | | |
| | Filter frame with mat | | | | | | | | | | |
| | Dummy plate bottom | | | | | | | | | | |
| Air outlet | Duct connection hood | | | | | | | | | | |
| | Air outlet hood with grille | | | | | | | | | | |
| | Duct connection hood | | | | | | | | | | |
| Other acces. | Set of brackets for horizontal design | | | | | | | | | | |
| | Explosion-proof hood as burner casing | | | | | | | | | | |
| | Set of lifting lugs for horizontal design | | | | | | | | | | |
| | Turbulator | | | | | | | | | | |
| Smoke tubes | Smoke tube branch with soot collector | | | | | | | | | | |
| | Smoke tube rain protection hood | | | | | | | | | | |
| | Smoke tube 1000 mm length, pluggable up to WSIWO 250 | | | | | | | | | | |
| | Smoke tube sleeve from WSIWO 400 on | | | | | | | | | | |
| | Smoke tube bend 90° with soot door | | | | | | | | | | |
| Electric fittings | Double and safety thermostat, fitted | | | | | | | | | | |
| | Terminal box, fitted | | | | | | | | | | |
| | Room thermostat | | | | | | | | | | |
| | Room thermostat with on/off switch | | | | | | | | | | |
| | Room thermostat clock with daily and weekly programm | | | | | | | | | | |
| | Servomotor 230 V open/shut, fitted | | | | | | | | | | |
| Switch board | Switch board Type | | | | | | | | | | |
| | with hours run meter | | | | | | | | | | |
| | with contactor control for threephase current burner/ampere..... | | | | | | | | | | |
| | with time switch with daily/weekly program and power reserve | | | | | | | | | | |
| Assembly | Wiring complete | | | | | | | | | | |
| | Burner plate type A <input type="checkbox"/> B <input type="checkbox"/> C <input type="checkbox"/> D <input type="checkbox"/> E <input type="checkbox"/> | | | | | | | | | | |
| | Burner plate special design | | | | | | | | | | |
| | Burner assembly with wiring | | | | | | | | | | |
| Terms of payment: | | | | | | | | | Total | | |
| Other: | | | | | | | | | ex factory unpacked | | |
| | | | | | | | | | freight / packaging | | |
| | | | | | | | | | Total | | |
| Place: | | | Date: | | | Signature: | | | | | |

Check the appropriate boxes of fill in the space provided referred view on the burner

| Pos. | Pieces | | Single price | Total price | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---------------------|-------------------------|---|------------------|-------------|------------------------------|------------|-------------------------|--------------|---------------------|----------|---------------------------------------|----------------|----------|-----------------|---------|---------|-------|-------------|------|--|------|-------|--|------------------|----------|------------------------------|------------|-------------------------|--------------|---------------------|----------|-----------------|----------------|----------|-------|---------|---------|-------|-------------|------|--|------|-------|--|------------------|----------|------------------------------|------------|-------------------------|-------|-----------------|----------|-------|-------------|------|--|------|-------|--|--|--|
| | | <p>WS 40-63 Warm air heaters by Wolf for oil, natural and liquid petroleum gas, as vertical or horizontal unit.</p> <p>Heating furnace partially consists of alloyed, heat resistant steel. Cleaning apertures are accessible from the burner and the smoke tube side. Inspection door is positioned above the burner opening. External casing consists of galvanized sheet steel with heat insulation.</p> <p>With fitted double inlet radial fan. Fan has a particularly low noise level, impeller is balanced statically and dynamically and fitted onto a vibrationfree motor.</p> <table> <tr> <td>Heating capacity</td> <td>kW</td> <td>Safety and double thermostat</td> </tr> <tr> <td>Air volume</td> <td>m³/h</td> <td>Terminal box</td> </tr> <tr> <td>Additional pressure</td> <td>Pa</td> <td>Switch board , 3-stage, fan operation</td> </tr> <tr> <td>Motor capacity</td> <td>kW</td> <td>Wiring complete</td> </tr> <tr> <td>Voltage</td> <td>V</td> <td>.....</td> </tr> <tr> <td>Manufacture</td> <td>Wolf</td> <td></td> </tr> <tr> <td>Type</td> <td>.....</td> <td></td> </tr> </table> <p>WS 100-400 Warm air heaters by Wolf for oil, natural and liquid petroleum gas, as vertical or horizontal unit.</p> <p>Heating furnace partially consists of alloyed, heat resistant steel. Cleaning apertures are accessible from the burner and the smoke tube side. Inspection door is positioned above the burner opening. External casing consists of galvanized sheet steel with heat insulation.</p> <p>With fitted, double inlet radial fan, impeller statically and dynamically balanced, shaft with strong roller bearing. Motor equipped with tension spindle, drive via pulleys and V-belts.</p> <table> <tr> <td>Heating capacity</td> <td>kW</td> <td>Safety and double thermostat</td> </tr> <tr> <td>Air volume</td> <td>m²/h</td> <td>Switch board</td> </tr> <tr> <td>Additional pressure</td> <td>Pa</td> <td>Wiring complete</td> </tr> <tr> <td>Motor capacity</td> <td>kW</td> <td>.....</td> </tr> <tr> <td>Voltage</td> <td>V</td> <td>.....</td> </tr> <tr> <td>Manufacture</td> <td>Wolf</td> <td></td> </tr> <tr> <td>Type</td> <td>.....</td> <td></td> </tr> </table> <p>WO 40-400 Warm air heaters by Wolf for oil, natural and liquid petroleum gas, as vertical or horizontal unit.</p> <p>Heating furnace partially consists of alloyed, heat resistant steel. Cleaning apertures are accessible from the burner and the smoke tube side. Inspection door is positioned above the burner opening. External casing consists of galvanized sheet steel with heat insulation.</p> <table> <tr> <td>Heating capacity</td> <td>kW</td> <td>Safety and double thermostat</td> </tr> <tr> <td>Air volume</td> <td>m²/h</td> <td>.....</td> </tr> <tr> <td>Unit resistance</td> <td>Pa</td> <td>.....</td> </tr> <tr> <td>Manufacture</td> <td>Wolf</td> <td></td> </tr> <tr> <td>Type</td> <td>.....</td> <td></td> </tr> </table> | Heating capacity | kW | Safety and double thermostat | Air volume | m ³ /h | Terminal box | Additional pressure | Pa | Switch board , 3-stage, fan operation | Motor capacity | kW | Wiring complete | Voltage | V | | Manufacture | Wolf | | Type | | | Heating capacity | kW | Safety and double thermostat | Air volume | m ² /h | Switch board | Additional pressure | Pa | Wiring complete | Motor capacity | kW | | Voltage | V | | Manufacture | Wolf | | Type | | | Heating capacity | kW | Safety and double thermostat | Air volume | m ² /h | | Unit resistance | Pa | | Manufacture | Wolf | | Type | | | | |
| Heating capacity | kW | Safety and double thermostat | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Air volume | m ³ /h | Terminal box | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Additional pressure | Pa | Switch board , 3-stage, fan operation | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Motor capacity | kW | Wiring complete | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Voltage | V | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Manufacture | Wolf | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Type | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Heating capacity | kW | Safety and double thermostat | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Air volume | m ² /h | Switch board | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Additional pressure | Pa | Wiring complete | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Motor capacity | kW | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Voltage | V | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Manufacture | Wolf | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Type | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Heating capacity | kW | Safety and double thermostat | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Air volume | m ² /h | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Unit resistance | Pa | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Manufacture | Wolf | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Type | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |